

CQC CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Certificate No.: CE240303009142

Product Air Circuit-breakers

Applicant Zhejiang Tengen Electric Co.,Ltd.
Sulv Industrial Area, Liushi Town, Yueqing City, Zhejiang
Province, P.R.China

Type/Model TGW3-2000,TGW3-2000H,TGW3-2500,TGW3-2500H;

Technical data See the Appendix

This is to certify that, on the basis of the tests undertaken as per Report No. 00901-CE2024CQC0303-014906, the submitted sample(s) of the above item complies with:

EN 60947-2:2017/A1:2020;EN 60947-2:2017

and fulfills testing requirements of the European Directive:

See the Appendix

This report is to verify the compliance of the sample submitted by the manufacturer only, and does not include the manufacturing process. Users shall affix the mark in accordance with the related legislation.

Valid from: Sep.26,2024

Valid until: Sep.25,2027

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE



CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Appendix

Page 1 of 2

Certificate No.: CE240303009142

TGW3-2000,TGW3-2000H,TGW3-2500,TGW3-2500H

Ui:1000V;Uimp:12kV;

Ue: AC380/400/415V,AC660/690V;

TGW3-2000,TGW3-2000H:

In:200A,250A,400A,500A,630A,800A,1000A,1250A,1600A,1900A,2000A;

TGW3-2500,TGW3-2500H:

In: 630A,800A,1000A,1250A,1600A,1900A,2000A,2500A;

Over-current release:Electronic type;

TGW3-2000:

Ue: AC380/400/415V

Icu: 70kA, Ics: 70kA, Icw: 66kA/1s;

Ue: AC660/690V

Icu: 50kA, Ics: 50kA, Icw:50kA/1s;

TGW3-2000H:

Ue: AC380/400/415V

Icu: 80kA, Ics: 80kA, Icw:66kA/1s;

Ue: AC660/690V

Icu: 65kA, Ics: 65kA, Icw:50kA/1s;

TGW3-2500:

Ue: AC380/400/415V

Icu: 80kA, Ics: 80kA, Icw: 66kA/1s;

Ue: AC660/690V

Icu: 65kA, Ics:65kA, Icw:55kA/1s;

TGW3-2500H:

Ue: AC380/400/415V

Icu: 85kA, Ics: 85kA, Icw:85kA/1s;

Ue: AC660/690V



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE


CE CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Appendix

Page 2 of 2

Certificate No.: CE240303009142

Icu: 65kA, Ics: 65kA, Icw:65kA/1s;
Selectivity category:B; 50/60Hz;
3P,4P; Applicable for isolation;
Auxiliary contacts:
3NO3NC, 4NO4NC, 5NO5NC, 6NO6NC
Ui:400V;Uimp:2.5kV;lth:16A;
AC-12:Ue/Ie:AC380V/16A;
DC-12:Ue/Ie:DC250V/5A.

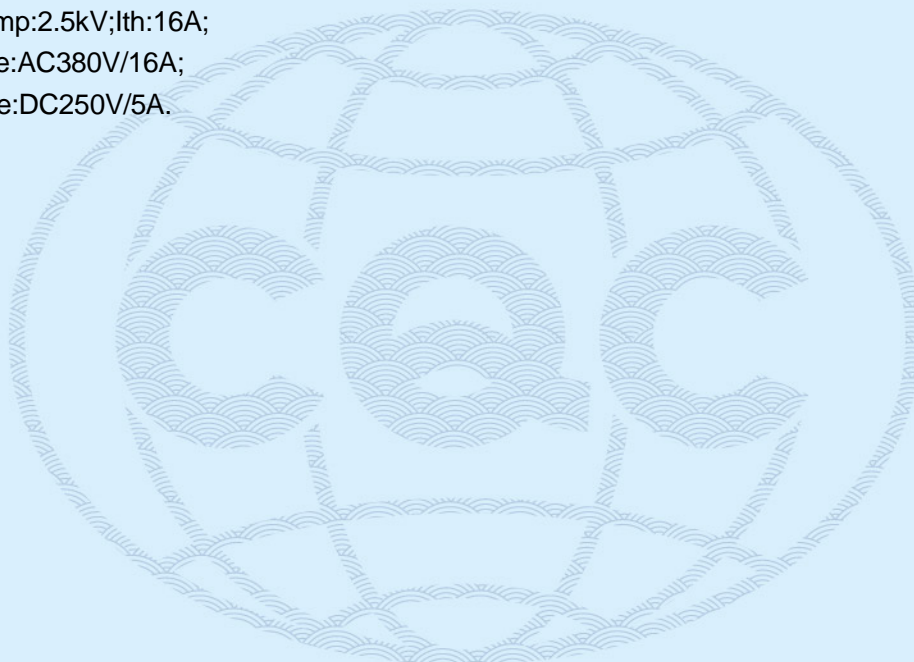

中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE